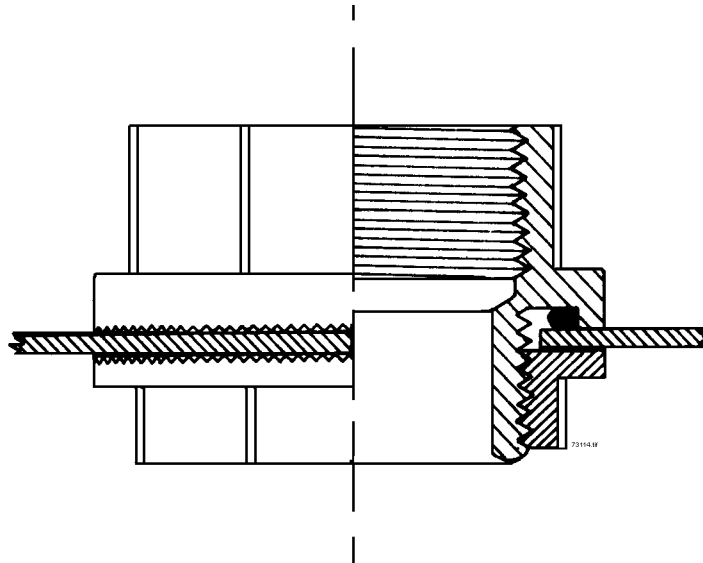


MATERIAL STANDARD**CONNECTOR – HUB
WATERTIGHT WITH O-RING GASKET**

Watertight Hubs with O-Ring Gaskets shall be of the general configuration shown and, when properly installed, shall provide a positive watertight seal and positive electrical ground.

Body: The threaded body and nut shall be zinc-base alloy die castings manufactured in accordance with ASTM B 86. The hub and nut flange surfaces shall be serrated to assure a positive electrical ground and vibration-proof service.

O-Ring: The O-Ring shall be neoprene rubber.

Reference Specification: ASTM B 86, latest revision

Stock Unit: EA

Stock Number	Conduit Size Inches	Approved Manufacturers	
		Steel City	Thomas & Betts
012092	1/2	H050-SC	H050-SC
731130	3/4	H075-SC	H075-SC
731131	1	H0100-SC	H0100-SC

ORIGINATOR	STANDARDS COORDINATOR	STANDARDS SUPERVISOR	UNIT DIRECTOR
<i>Jim S. Horn</i>	<i>Charles L. Shaffer</i>	<i>John C. Hinner</i>	<i>Harold J. J.</i>